


E.5.4 - SINGLE PHASE TRANSFORMER PAD OR SECONDARY DOME LOCATION WITH SIDEWALK AND PLANTER



NOTES:

1. TRANSFORMERS AND SECONDARY DOMES TO BE CENTERED ON THE PROPERTY LINE.
2. TRANSFORMERS AND SECONDARY JUNCTION BOXES TO BE LOCATED AS PER THE ELECTRICAL DESIGN PROVIDED BY LEHI CITY.
3. TRANSFORMER AND OTHER EQUIPMENT FRONTS TO BE INSTALLED SO THAT THE FRONTS ARE FACING THE SIDEWALK. NO OBSTRUCTIONS ARE ALLOWED IN FRONT OF LEHI CITY'S POWER EQUIPMENT.
4. SPARE CONDUITS SHALL BE CAPPED 2" ABOVE FINAL GRADE.

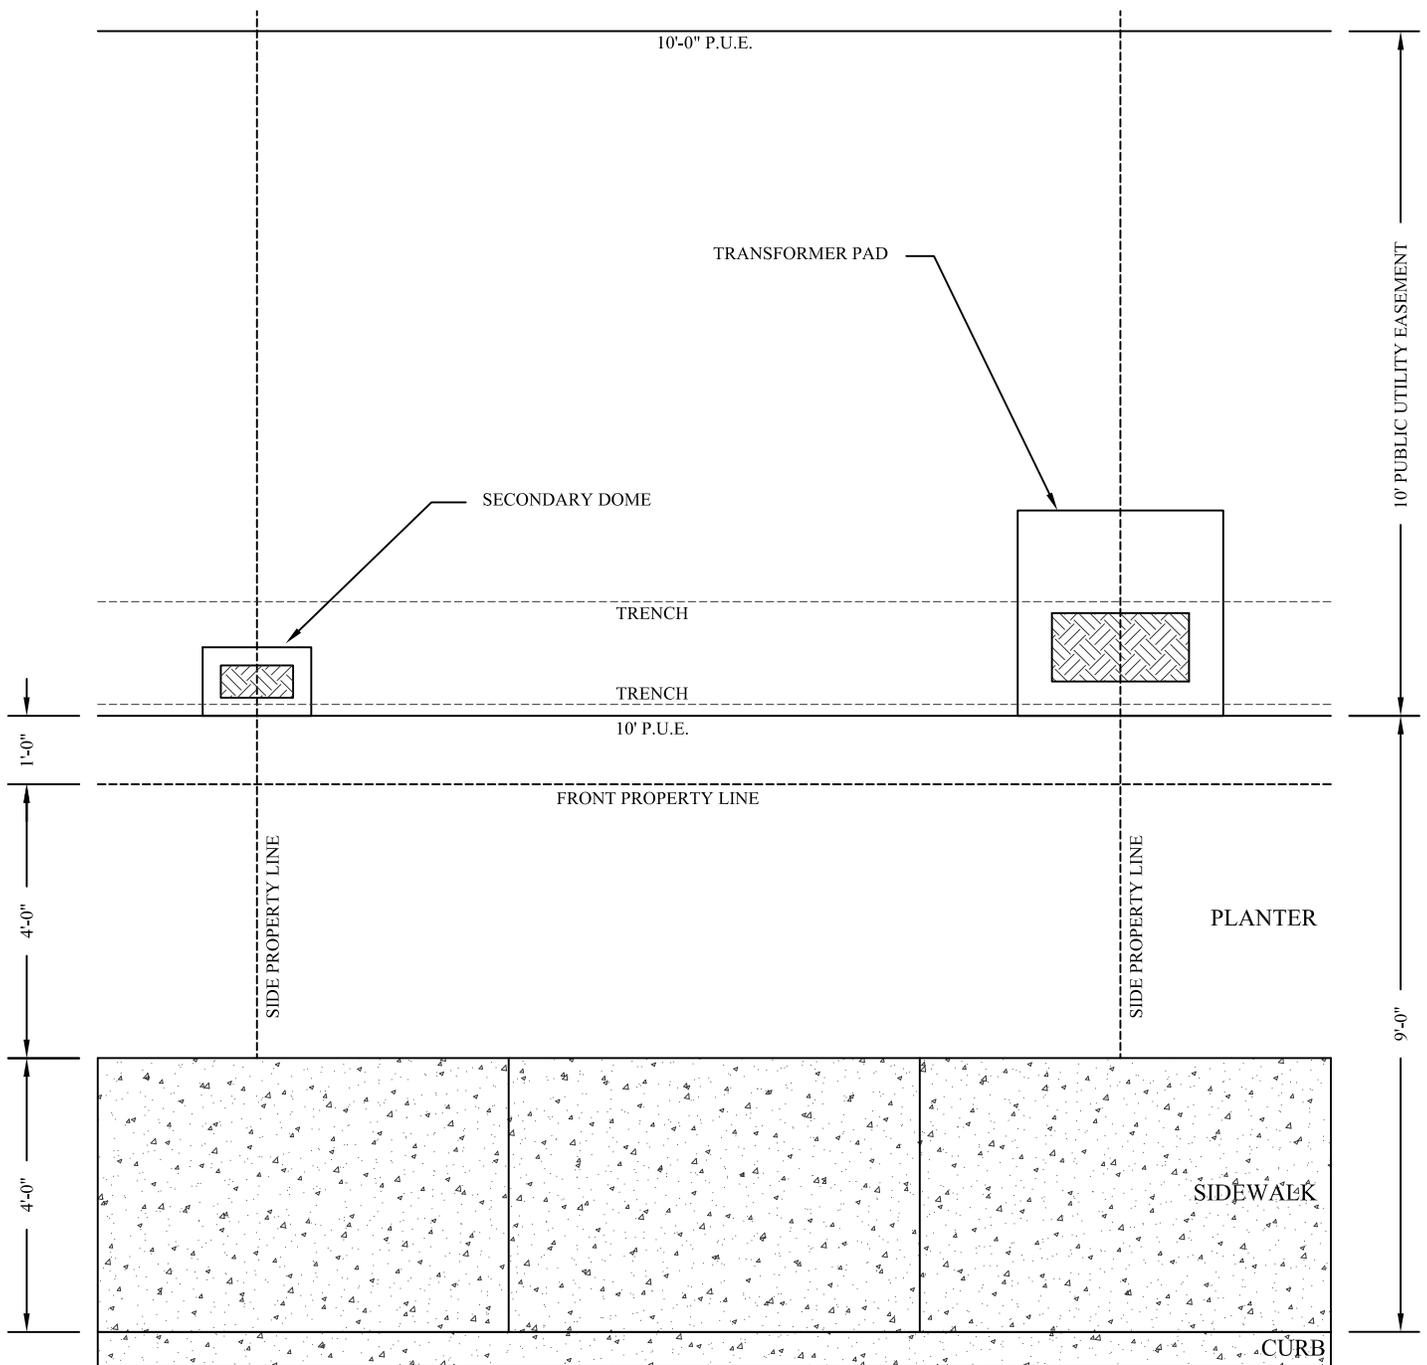

LEHI CITY ELECTRICAL REQUIREMENTS & STANDARDS MANUAL EQUIPMENT LOCATION SPEC.

ELECTRIC 5.4
1 PHASE TRANSFORMER PAD
SCALE: NONE
DATE: 7.22.06
REV: A
REV DATE: 7.22.06