E.5.8 - THREE PHASE TRANSFORMER CONCRETE PAD WITHOUT CT RACK

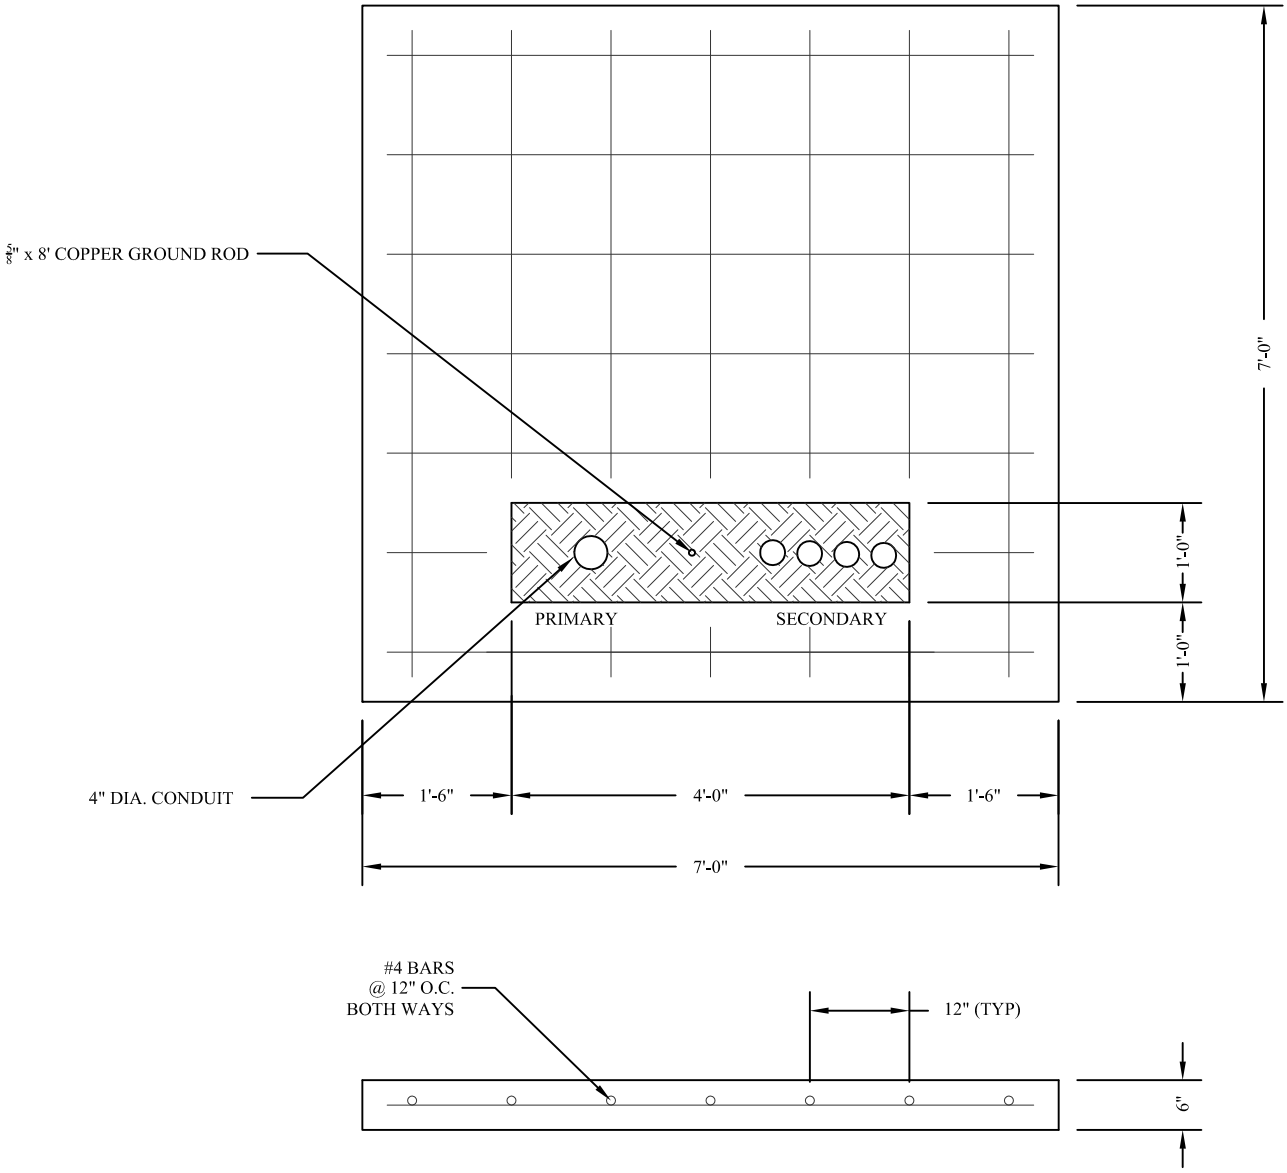

NOTES:

1. CONCRETE SPECIFICATION REFERENCE SECTION #5 OF THE LEHI STANDARDS BOOKWITH CLASS "B" CONCRETE MINIMUM.

LEHI PIONEERING UTAH'S FUTURE	LEHI CITY ELECTRICAL REQUIREMENTS & STANDARDS MANUAL THREE PHASE TRANS. PAD	ELECTRIC 5.8
		THREE PHASE CONCRETE PAD
		SCALE: 1/2"=1'-0"
		DATE: 7.22.06
		REV: A
		REV DATE: 7.22.06