


## E.5.9 - THREE PHASE TRANSFORMER PAD WITH METERING STATION



**NOTES:**

1. FOR CONCRETE SPECIFICATIONS REFERENCE SECTION #5 OF THE LEHI STANDARDS BOOK.
2. LEHI CITY WILL NOT PULL OR TERMINATE COMMERCIAL SERVICES FROM SECONDARY SIDE OF TRANSFORMER.
3. DEVELOPER SHALL TERMINATE ALL CABLES FROM THE CT CANS IN.
4. CONTRACTOR SHALL TERMINATE ALL CABLES THEY RUN.

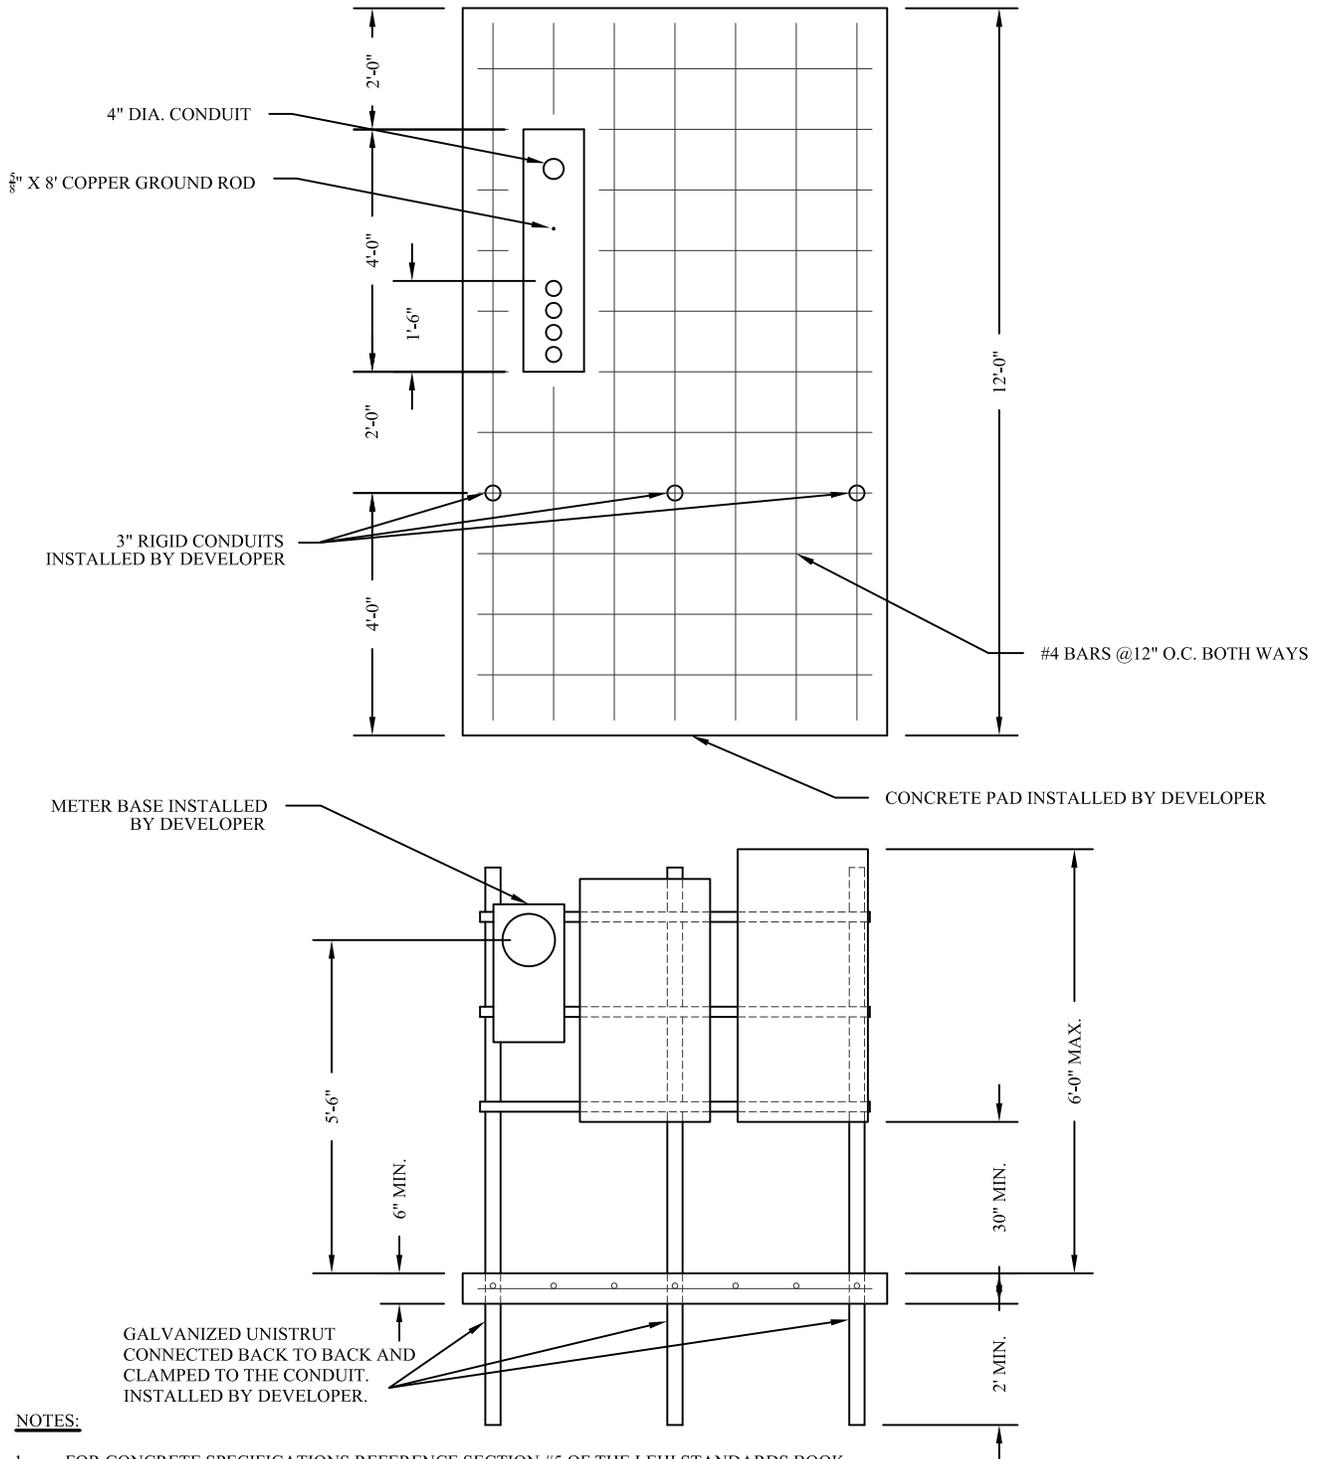

### LEHI CITY ELECTRICAL REQUIREMENTS & STANDARDS MANUAL 3 PHASE TRANSFORMER PAD

ELECTRIC 5.9
3 PHASE TRANSFORMER PAD
SCALE: NONE
DATE: 7.22.06
REV: A
REV DATE: 1.11.10