

# PRE-INSPECTIONS REQUIRED ON ALL SERVICE UPGRADES.

PERMIT APPLICATION FOR ELECTRICAL SERVICE UPGRADE MUST BE COMPLETED BY OWNER/CONTRACTOR PRIOR TO PRE-INSPECTION OF ELECTRICAL SERVICE UPGRADE. ALL SERVICE UPGRADES REQUIRE A PRE-INSPECTION.

ALL ELECTRICAL SERVICE UPGRADE INSTALLATIONS SHALL MEET LEHI CITY POWER / BUILDING INSPECTION SERVICE SPECIFICATIONS, NATIONAL ELECTRICAL CODE AND NATIONAL ELECTRICAL SAFETY CODE LATEST REVISIONS.


**ADDRESS SHALL BE POSTED AT BUILDING SITE.**

METER & SERVICE LOCATIONS ARE TO BE DETERMINED BY LEHI CITY POWER. (SEE ATTACHMENT TO JOB COPY DRAWINGS). GENERAL RULES FOR THE SERVICE LOCATION ARE AS FOLLOWS: THE METER AND MAIN DISCONNECT SHALL BE SETBACK FROM THE FRONT CORNER OF THE STRUCTURE A MAXIMUM OF 10 FEET. THE METER & MAIN DISCONNECT SHALL BE ON THE SIDE OF THE STRUCTURE CLOSEST TO THE DISTRIBUTION POWER SOURCE INTENDED FOR THAT SITE.

ALL SERVICE UPGRADES NOT CONFORMING TO CURRENT LEHI CITY POWER / BUILDING INSPECTION STANDARDS SHALL BE DENIED. LINE SIDE JUNCTION BOXES AND ELECTRICAL GUTTERS ARE NOT ALLOWED. ALL UNUSED ELECTRICAL EQUIPMENT SHALL BE REMOVED.

LEHI CITY POWER SHALL INSPECT TRENCH AND CONDUIT INSTALLATION PRIOR TO BACKFILL. (CALL TO SCHEDULE ELECTRICAL SERVICE TRENCH INSPECTIONS)

NOTE: CHECK WITH BUILDING INSPECTION ABOUT LABELING EACH OUTSIDE METER BASE AS WELL AS EACH INSIDE BREAKER PANEL WITH A PERMANENT LABEL.

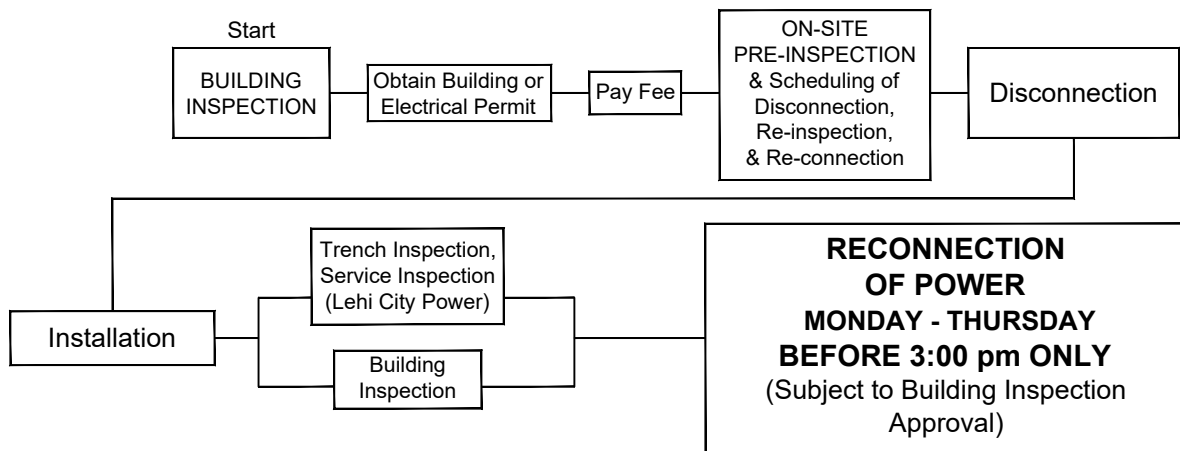

**REQUIREMENTS & STANDARDS**  
**SERVICE UPGRADE**  
**PROCESS &**  
**REQUIREMENTS**  
**RESIDENTIAL & COMMERCIAL POWER SERVICE**

DWG: **2.4**

REV. 0.00

BY: GWK/BT

DATE: 4/10/17