


DRAWING: LPS DWG-08 REVISED JAN-2016



NOTES:

1. LEHI POWER SHALL PROVIDE AND SET POLE AND RISER; PROVIDE, PULL & TERMINATE CONDUCTORS.
2. EQUIPMENT BASE SHALL BE SET LEVEL AND ALIGNED WITH THE WALK OR ADJACENT ENTITIES TO PROVIDE A NEAT APPEARANCE.
3. CONDUIT AND EQUIPMENT SHALL BE PLACED AFTER CURB, GUTTER AND WALK TO ASSURE CORRECT PLACEMENT WITHIN THE EASEMENT.
4. FOR DEVELOPMENT WITHOUT WALKS, PLACE EQUIPMENT 3' MINIMUM BEHIND CURB.

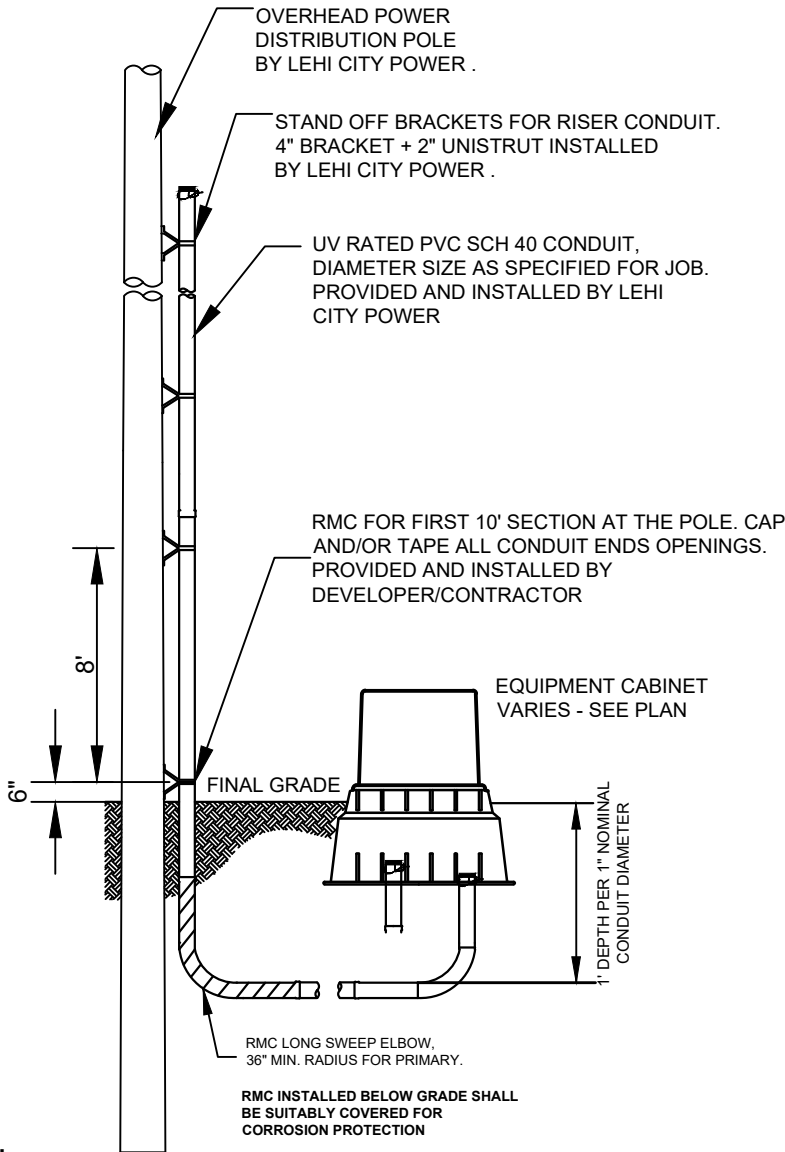

REQUIREMENTS & STANDARDS

RISER POLE

(OVERHEAD TO UNDERGROUND)

(LOCATIONS IN THE P.U.E.)

DWG: **4.1.6**

REV. 0.00

BY: GWK/BT

DATE: 3/16/17