
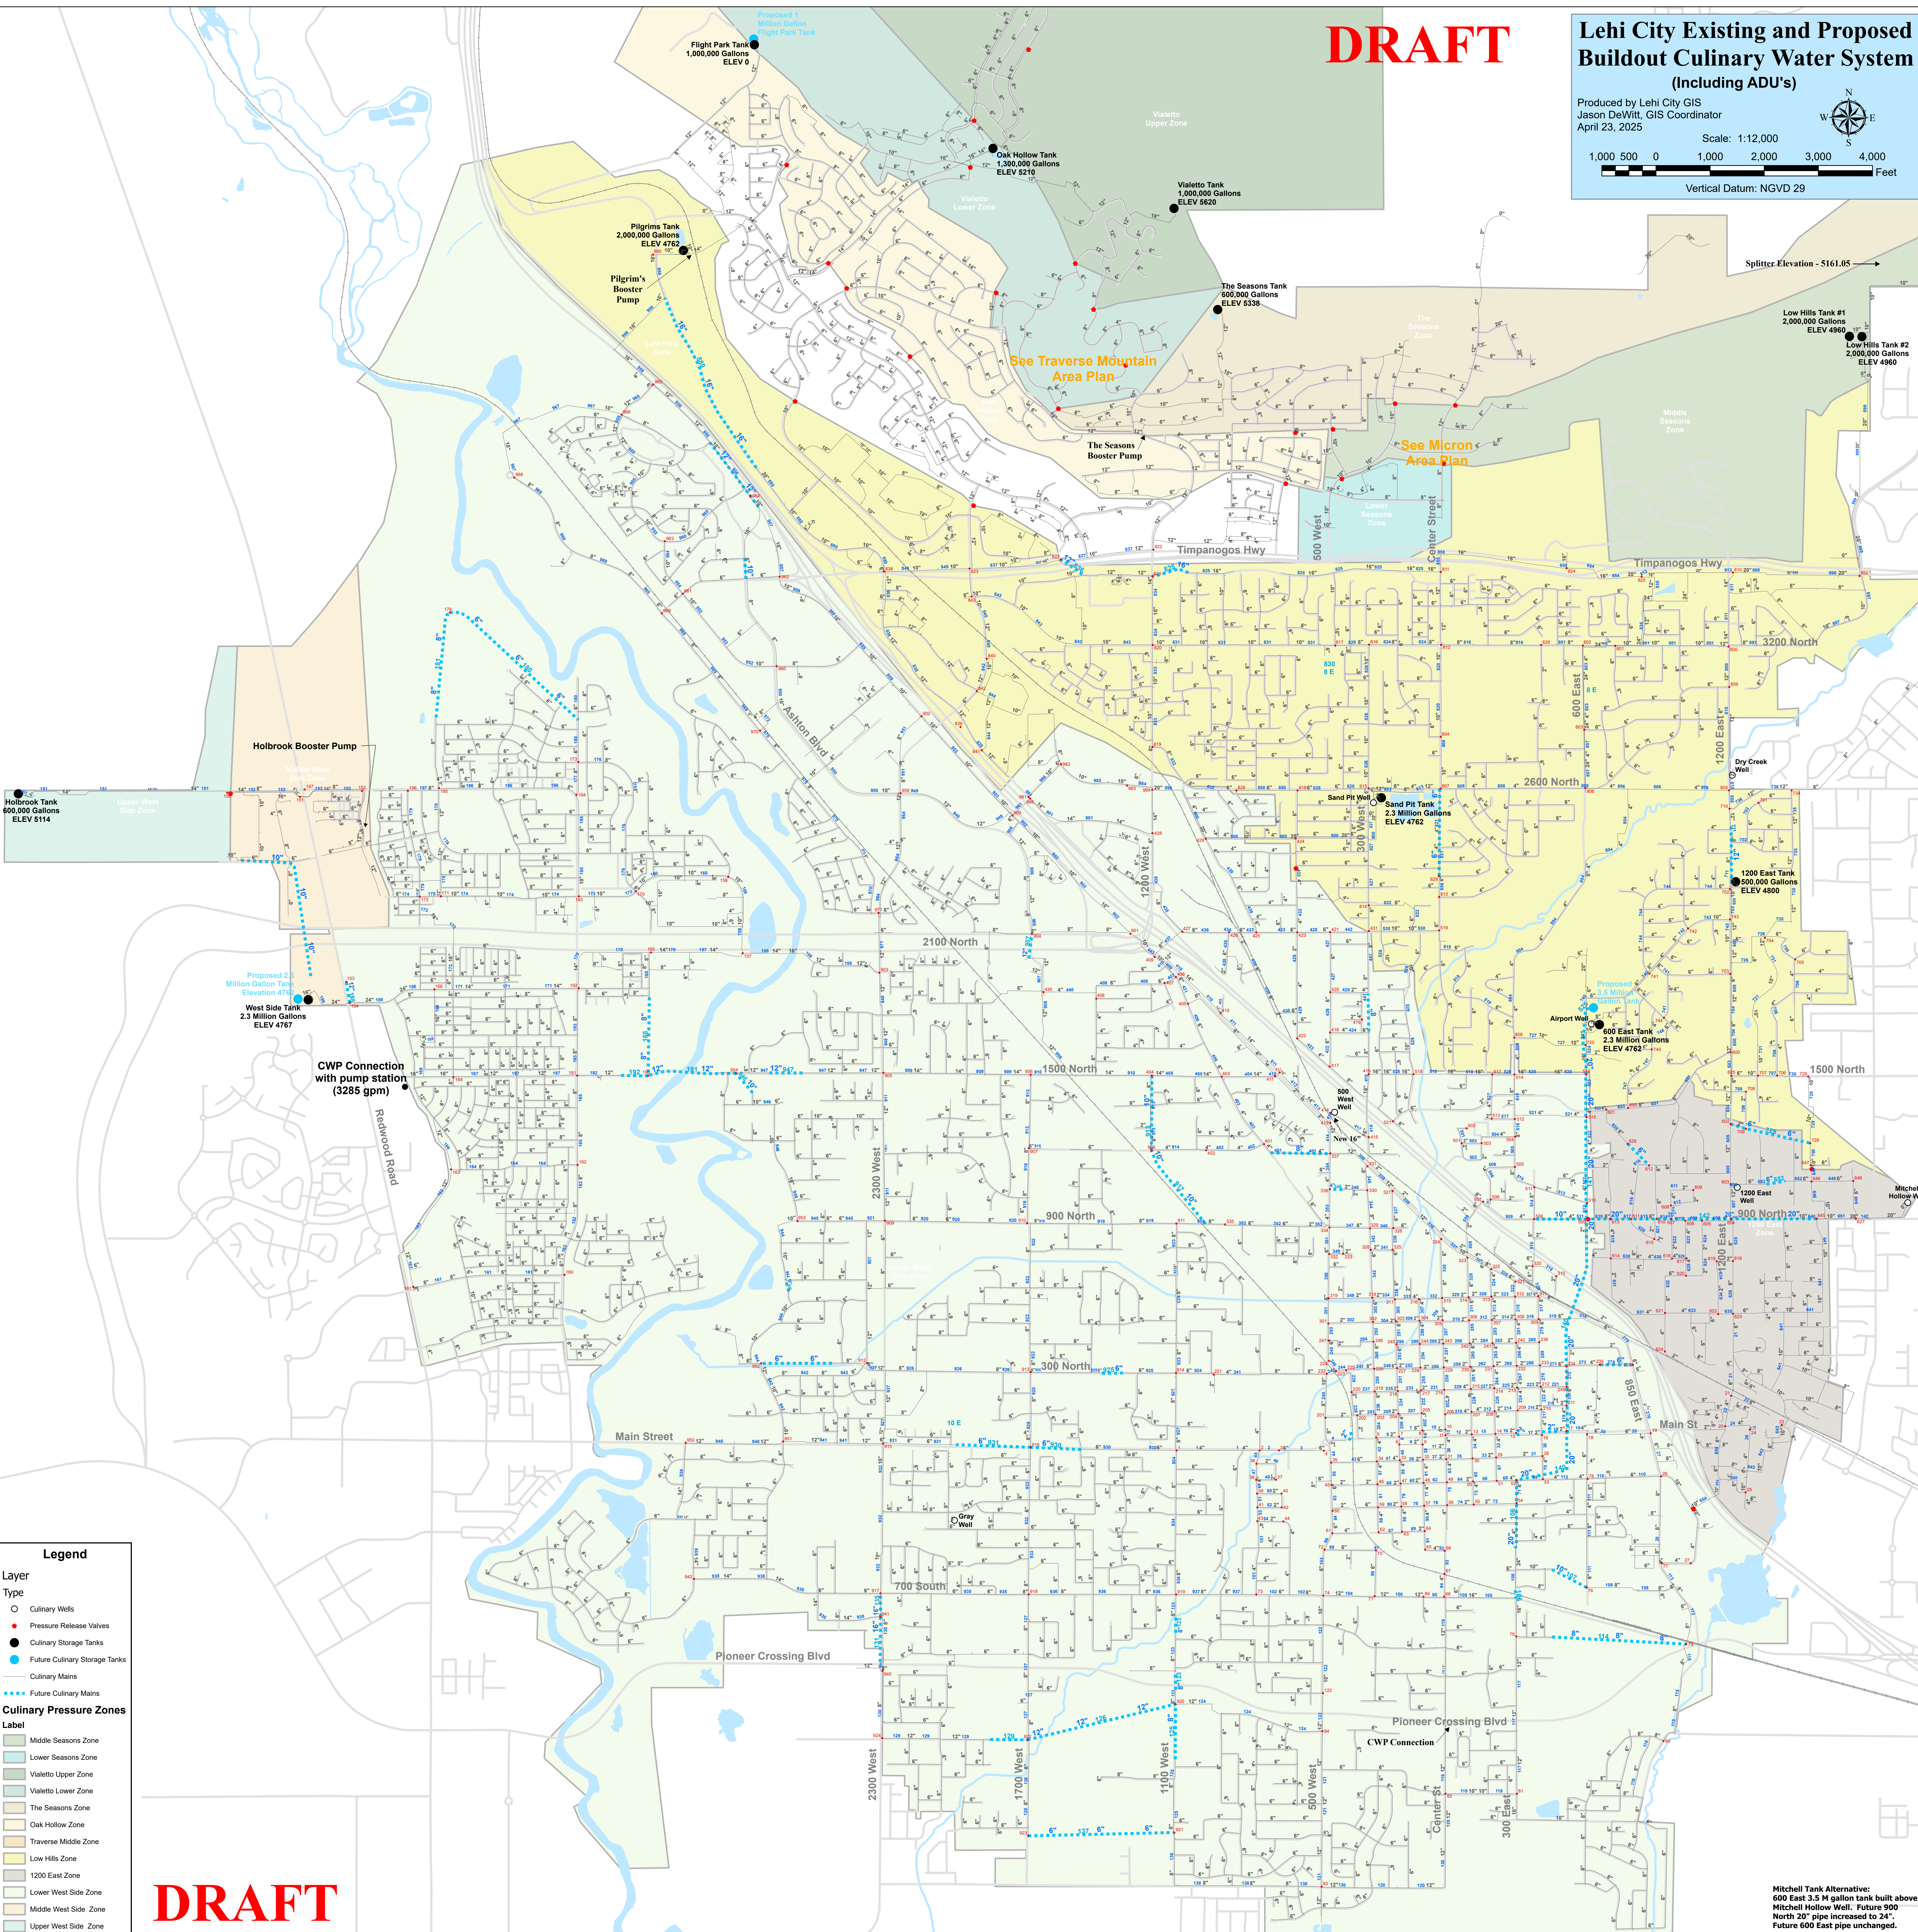


DRAFT

Lehi City Existing and Proposed Buildout Culinary Water System (Including ADU's)

Produced by Lehi City GIS
Jason DeWitt, GIS Coordinator
April 23, 2025

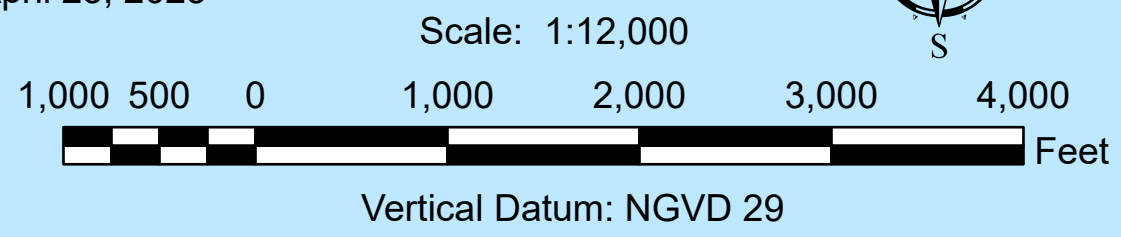

Legend

Layer

Type

- Culinary Wells
- Pressure Release Valves
- Culinary Storage Tanks
- Future Culinary Storage Tanks
- Culinary Mains
- Future Culinary Mains

Culinary Pressure Zones

Label

- Middle Seasons Zone
- Lower Seasons Zone
- Vialetto Upper Zone
- Vialetto Lower Zone
- The Seasons Zone
- Oak Hollow Zone
- Traverse Middle Zone
- Low Hills Zone
- 1200 East Zone
- Lower West Side Zone
- Middle West Side Zone
- Upper West Side Zone

DRAFT

Mitchell Tank Alternatives:
600 East 3.5 M gallon tank built above Mitchell Hollow Well. Future 900 North 20" pipe increased to 24". Future 600 East pipe unchanged.